



**Notes**


- FOUNDATIONS**
1. Foundation and Slab to Engineers Specification in Line with individual Geotechnical Conditions.
- WALLS**
2. M140, 3.5 MPa Concrete Blocks
  3. External Wall Finish to be Rendered and Painted
  4. Internal Wall finish to be Plastered and Painted
  5. Internal Wall to be Bonded to External Wall by means of 30 x 1.2mm Galvanized Hoop Iron Straps with Both Ends Bent Down into Hollow Block Filled Solid with 15MPa Concrete where the Hoop Iron Straps are installed.
  6. Brick-force Reinforcement to be 2.8mm Galvanized Placed Every Second Course.
  7. 1 Steel Ring Beam
  8. Precast Concrete Lintel to be Provided over Door Opening in Internal Wall.
- WINDOW**
9. Standard Clisco Steel Window Frame Type as Shown on the Elevation, Painted with one coat Primer and One Coat Egloss Enamel. The core of hollow units immediately adjacent to opening to be Reinforced with 1Y10 Vertical Bar extending from floor level to the top of lintel and filled solidly with 25MPa
  10. Glazing 3mm Clear Eglass
  11. Reveal Around Window 150mm Plaster Band
- DOOR**
12. Standard Pressed Metal Door Frame painted with One Coat Primer and One Coat Gloss Enamel.
  13. The Steel Door Frame to be Set in Position Securely Braced and lugs built into block Work and turned down into hollow block . The core of hollow units immediately adjacent to opening to be Reinforced with 1Y10 Vertical Bar extending from floor level to the top of lintel and filled solidly with 25MPa .Hollow of steel door frame to be filled solid with 25MPa concrete as the build proceeds.
  14. Internal door to be Masonite with 2 Lever SABS Lock Set and External Door to be solid Pine Sealed with 3 Lever SABS Lock Set.
- ROOF**
15. 22.5° Roof Pitch Concrete Tiles on 38 x 38 Battens (c/c to suit) on Membrane, on Gang-nailed trusses SA Pine Grade 5. Wall Plates 38 x 76mm with Standard Ridge Capping. All Fixing in Accordance with Manufacturers Specifications
  16. Trusses Tied Down with 2 Stands of 4.0mm Diameter galvanized steel wire wrapped around bottom reinforcement bar in bond block steel beam.
  17. All Exposed Timber to be Treated with Approved Preservate
- CEILING**
18. 6.4mm Rhinoboard flush plastered with 75mm Cove Cornice.
  19. Insulation : 130mm thick material fiberglass blanket Insulation.
  20. Trap door standard 600 x 600 installed in passage between bedrooms.
- LANDSCAPE**
21. An Area Extending to 1500mm Beyond the Perimeter of the Dwelling to be Cleared of all Refuse and Vegetation Including Trees and shrubs; The Ground to slope Away from the Dwelling at a Gradient of 300mm in 1500mm and Any Loose or Disturbed Ground to be Compacted to a Minimum of 93% Mod AASHTO.
- GENERAL**
21. All Work to comply with NHBC Requirements.

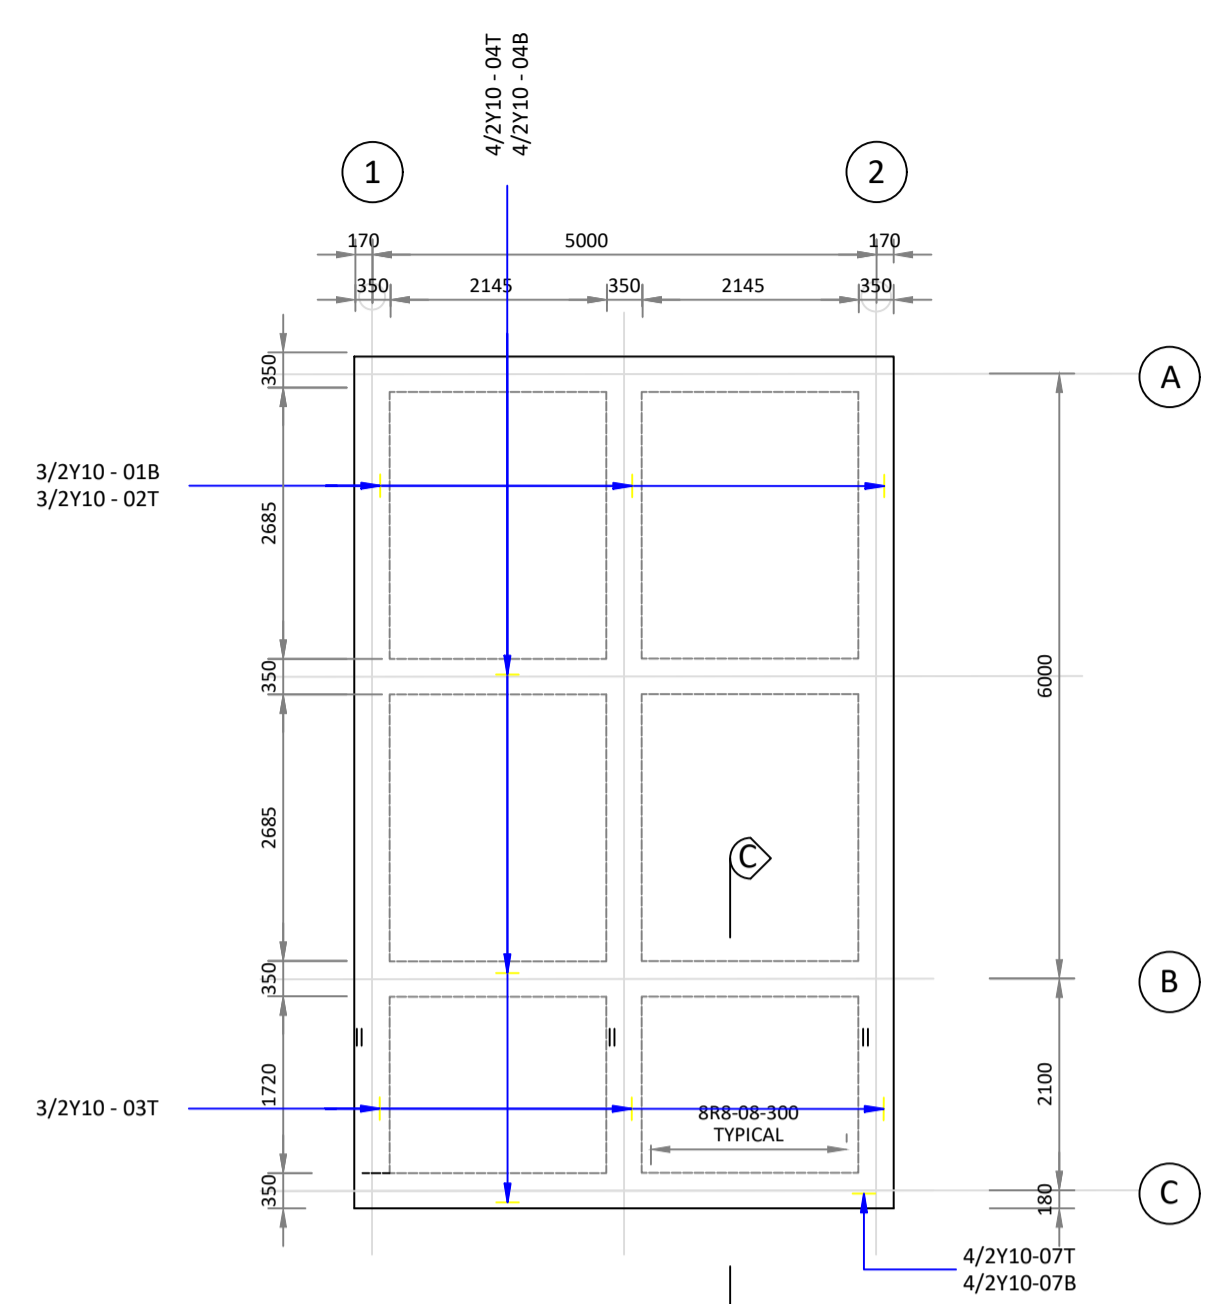


**Raft Foundation Reinforcement**  
Scale 1:75

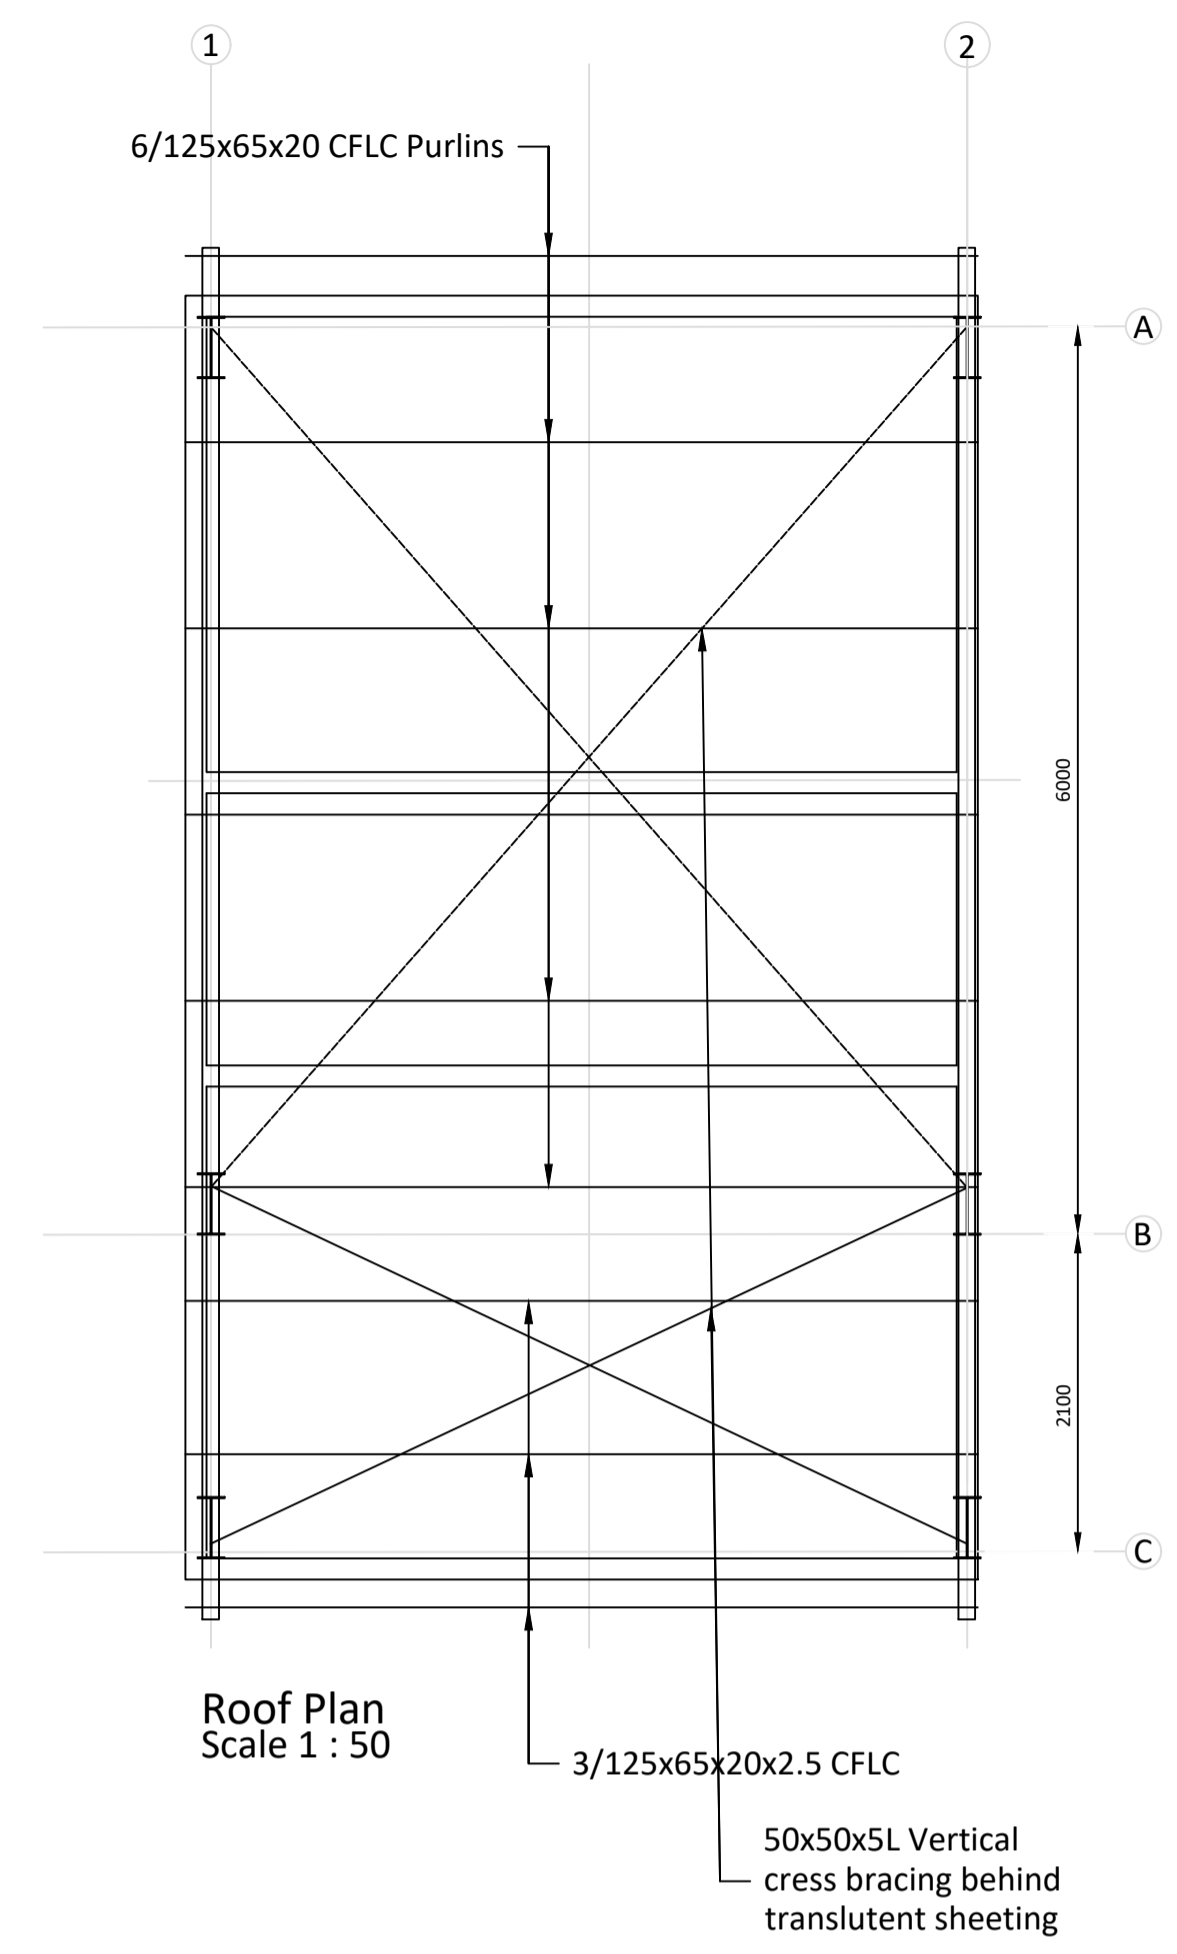


**Roof Plan**  
Scale 1 : 50

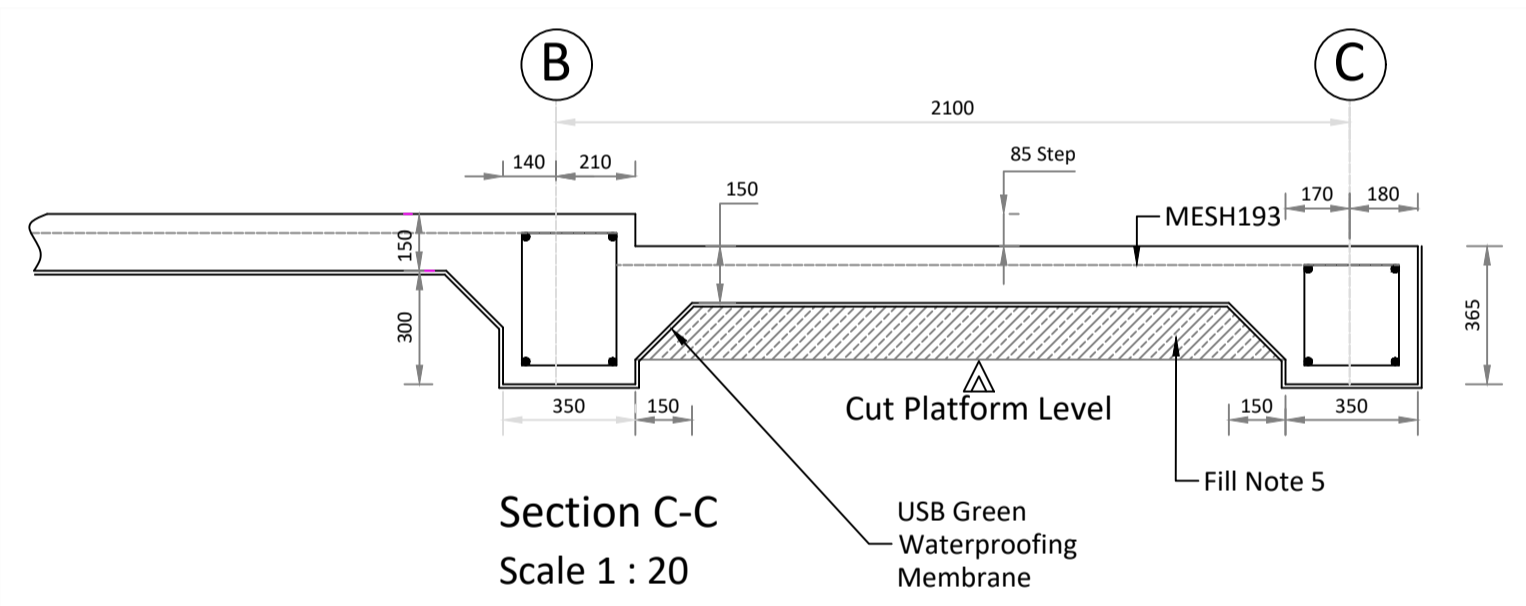


**Section C-C**  
Scale 1 : 20

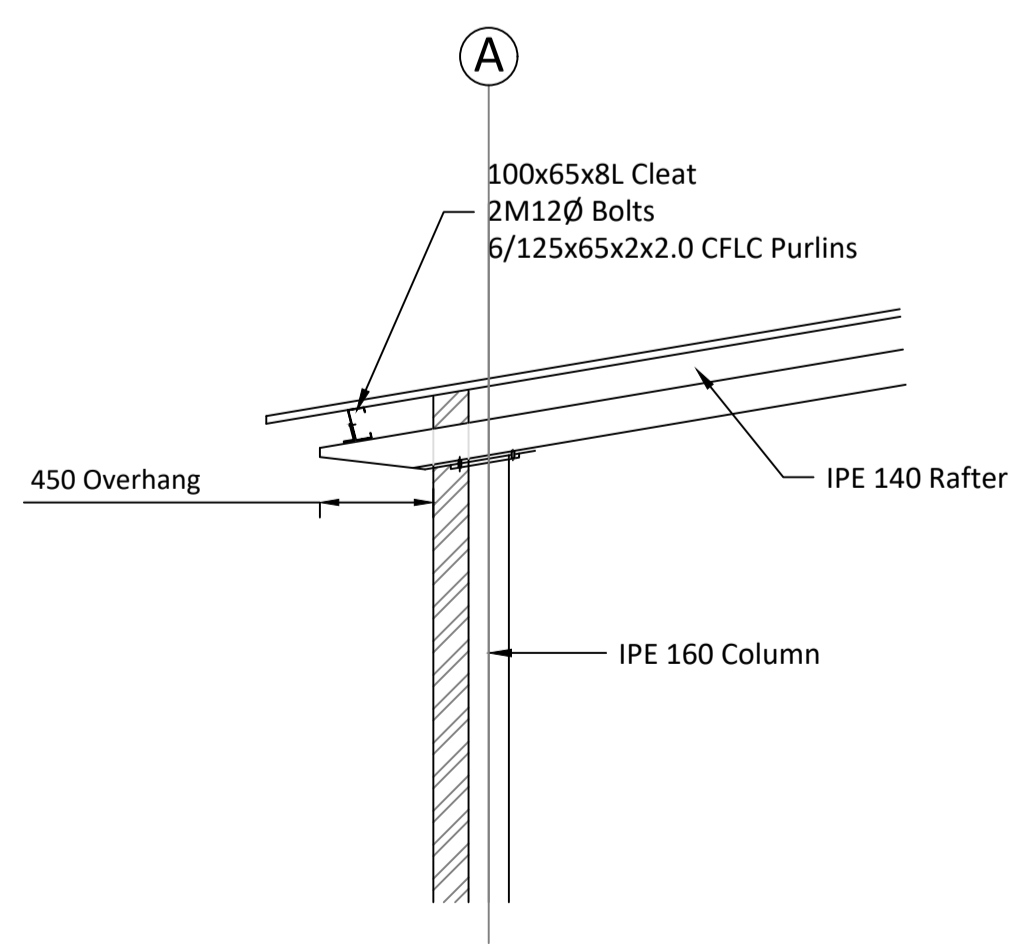


**Detail A**  
Scale 1:30

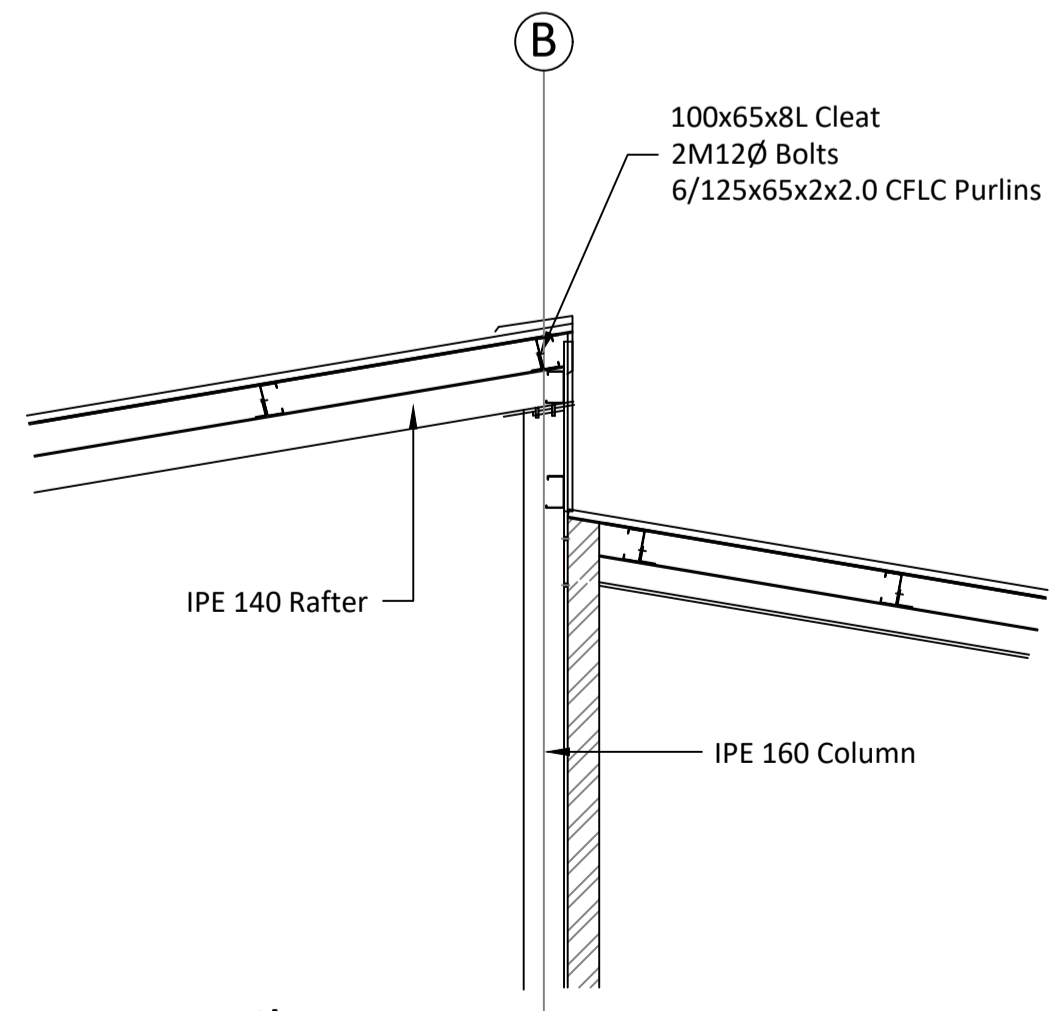

**Detail B**  
Scale 1:30

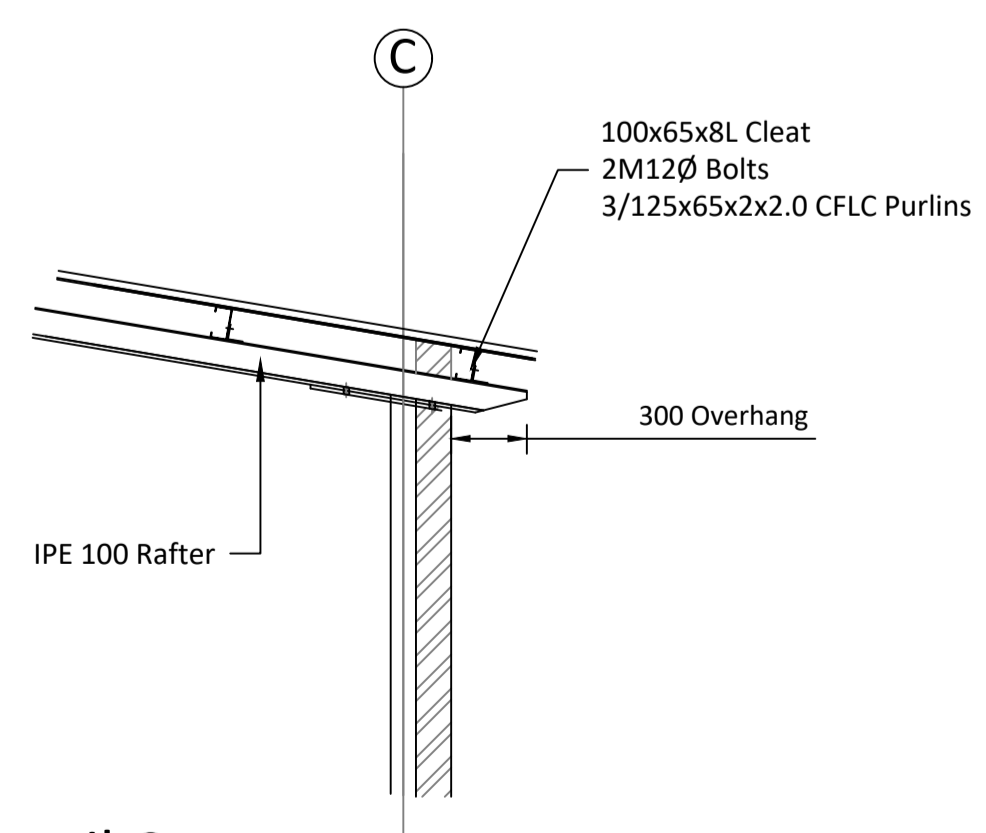

**Detail C**  
Scale 1:30

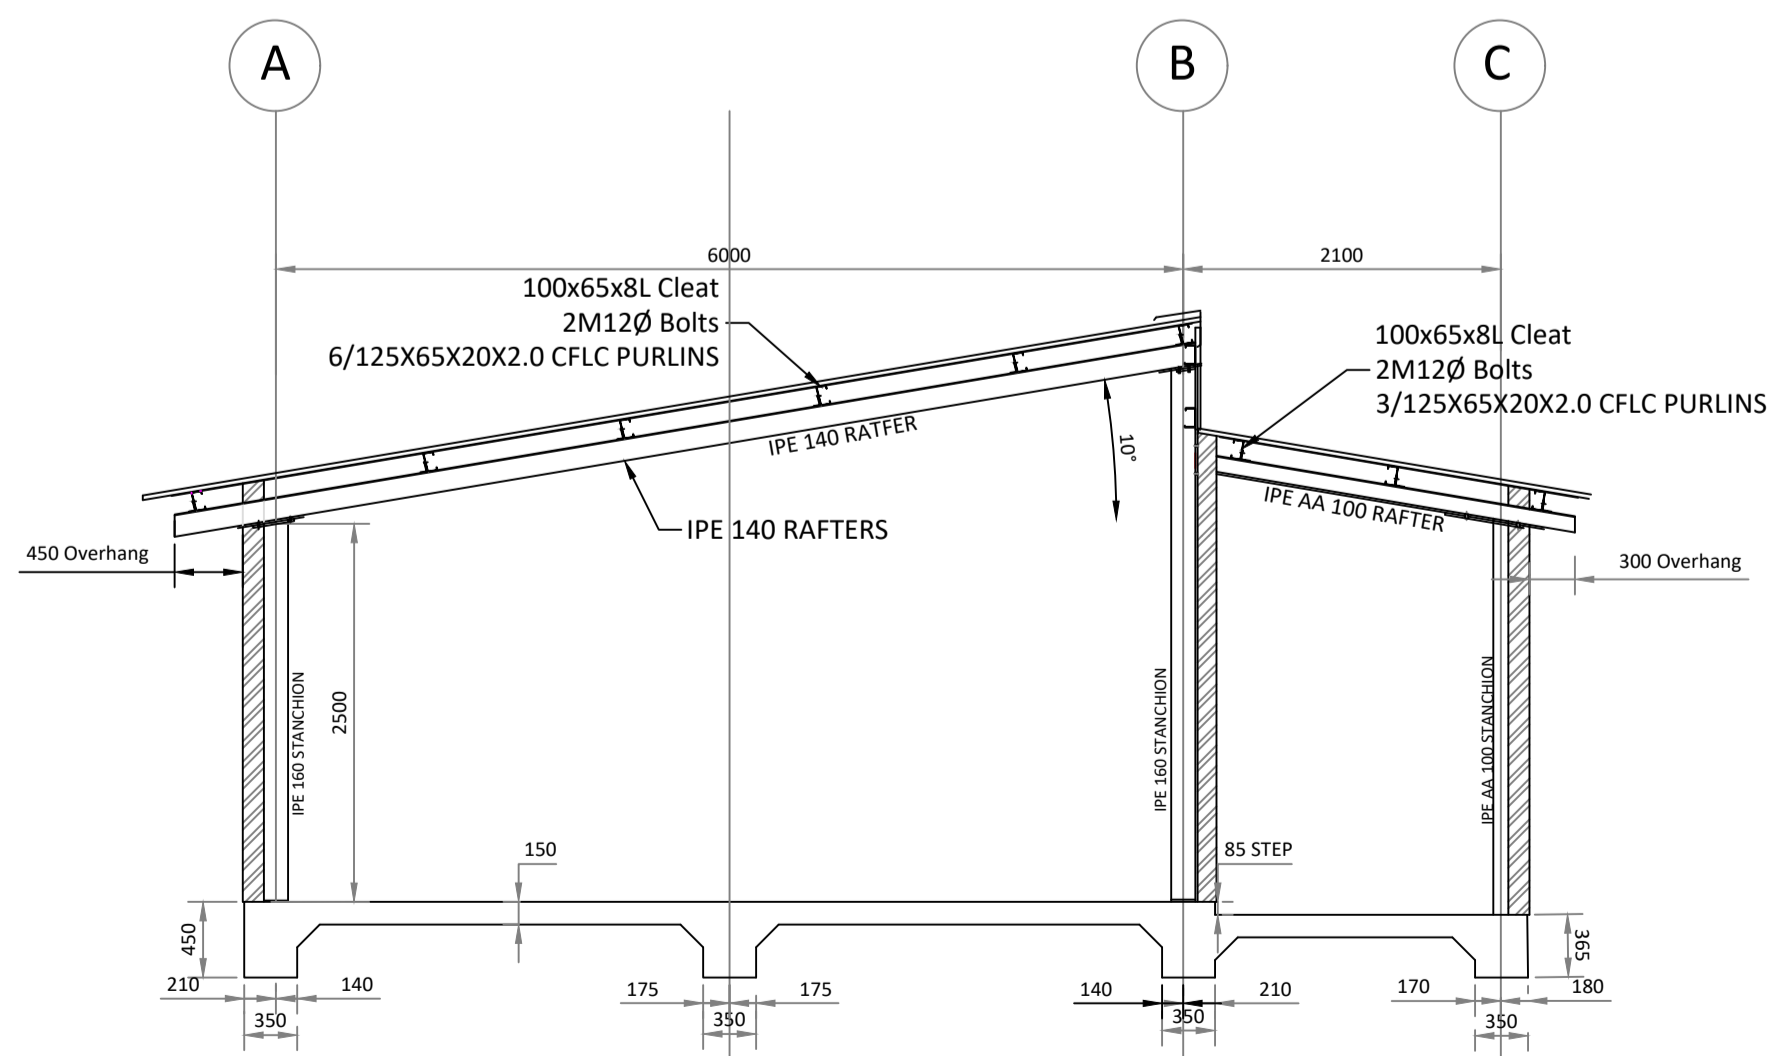

**TYPICAL SECTION**  
**Portal Frame At 5000 c/c**  
Scale 1:50

**Reference Drawing**

Ref Number	Description

Revision Details	By	Rev Date	Suffix

**Client**  
**LIMA**

**Ladysmith**  
XXXXXXXXXXXX P.O. Box XX  
Kwazulu-Natal XXXX  
Tel.: (XXX) XXX-XXXX Fax : (XXX) XXX-XXXX

**Approved On Behalf Of Client**  
By: \_\_\_\_\_

**Signature:**  
**HEMINGWAY AND ASSOCIATES cc**  
Consulting Engineers

Fuschia Grove Farm  
D183 Mount West  
P.O. Box 91 Mooi River 3300  
Kwa-Zulu Natal  
South Africa

Email: Rob.Archer@bundanet.com  
Cell: +27 (83) 460-9356



**Approved On Behalf Of Hemingway And Associates**  
By: \_\_\_\_\_ (Pr. No.)  
**Signature:**  
**Date:**  
**Project**

**Stand Alone**  
**Admin/Kitchen**

**Title**  
**Foundation**  
**and**  
**Roof Structural Details**

Scale  
**As Shown**

Drawn <b>N.G.K.</b>	Designer <b>M.S.H.</b>	Date
Check <b>M.S.H.</b>	Tech Check <b>M.S.H.</b>	14-Jan-19
Project Number <b>17018</b>	Drawing Number <b>SC201</b>	Revision